

AWARENESS SYSTEM IMPLEMENTED IN THE EUROPEAN NETWORK

František Janíček* — Martin Jedinák** — Igor Šulc***

Transmission system in Slovakia is part of a synchronously interconnected system of continental Europe. Besides indisputable technical and economical benefits of cooperation many hazardous factors exist of fault condition spreading with impact on our system. Even today a system break-up escalated into a vast blackout is a real danger. European transmission system operators continually work on preventive measures and develop systems with a goal to handle critical situations. The ambition of the European Awareness System is to signalize the rise of these situations and also assist with system restoration.

Key words: transmission system, European Awareness System, system state, real-time operation, area control error

1 INTRODUCTION

During the power system operation arise a lot of fast changes, which can cause a disproportion between production and consumption of electricity what also means big changes of rotor angles. [1]

The primary target of power system operation is the safety and reliability of the system. Moreover, in electrical power engineering, these terms (security, reliability) are very closely related and cannot be separated. Reliability significantly affects the safety and economy of system operation. Safety is associated with eliminating and minimizing of the failures probability that could lead for example to the threat of human life or another potential danger for the environment. Power system has to comply with the safety and reliability parameters at any time, because it is difficult to imagine such a large system that is safe on the one side and unreliable, or vice versa. [2]

After interconnection of European transmission systems into one system controlled by several operators and endeavour to enhance the security and reliability of electric energy delivery to the final customers, a need to monitor the status of the whole European system in real time arose. One of the consequences of the incident report of the Union for Coordination of the Transmission of Electricity (UCTE) is a recommendation to create an information platform allowing transmission system operators (TSOs) to observe in real-time the actual state of the whole UCTE system in order to quickly react during large disturbances [1]. To fulfil this need and to improve cooperation and coordination of member systems operations, the European Network of Transmission System Operators for Electricity (ENTSO-E) has developed the European

Awareness System (EAS) which provides sharing of selected data [2]. This new system allows, against similar tools, broader coordinated, faster and more efficient reactions to critical situations of individual operators even in greater distances from their own systems.

2 GENESIS AND MAIN GOALS

On 18th February 2011, after realizing the necessity of having such a tool for operational planning and analysis of transmission systems, the members of ENTSO-E signed a Memorandum of Understanding regarding the exchange of data in which the TSOs set forth their willingness to actively participate in the data exchange mechanism for the operational TSO business defined as real time and periodical tasks performed for transmission system operational planning, operations and analysis. In 2011 and 2012, testing of the system by pilot TSOs and evaluation of their experience took place. In the first quarter of 2013, the ENTSO-E Awareness System (EAS) software was completed, and distributed to individual member TSOs throughout the rest of the year. By the end of the year all 41 members of ENTSO-E signed a mutual EAS Data Exchange and Delivery Agreement and were connected to the system. Officially, full operation of EAS is dated on 5th November 2013. Until the end of 2014 implementation of an archive of exchanged data and providing an access to it for all TSOs is anticipated.

EAS ensures instantaneous, *ie*, real time exchange of relevant information about the operation between individual TSOs that allows them to promptly react in the case of unusual system conditions. Thanks to this system the awareness of all dispatchers of whole pan-European

* Institute of Power and Applied Electrical Engineering, Slovak University of Technology, Ilkovičova 3, 812 19 Bratislava, frantisek.janicsek@stuba.sk; ** Slovenská elektrizačná prenosová sústava, a.s., Obchodná 2, 010 08 Žilina, martin.jedinak@sepsas.sk; *** Slovenská elektrizačná prenosová sústava, a.s., Mlynské nivy, 59/A 824 84 Bratislava, Slovakia

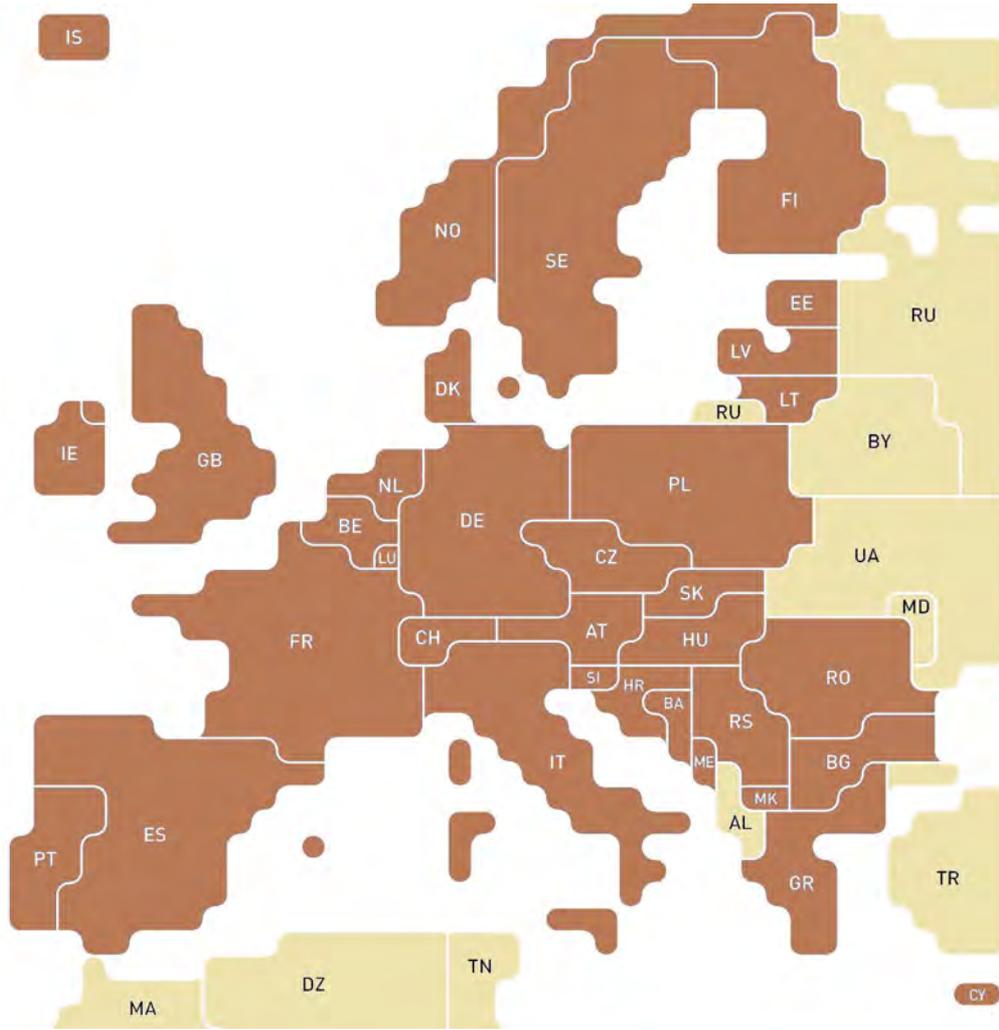


Fig. 1. Member countries of ENTSO-E, [4]

Table 1. Exchanged parameters

Data	Unit	Precision	Frequency
1 Frequency	Hz	< 20 mHz	Every supervisory control and data acquisition (SCADA) cycle, and at worst not more than every 10 seconds
2 Area Control Error (ACE)			According to the cycle of secondary controllers (SCADA-like measurement cycle), and at worst not more than every 10 seconds
3 Scheduled total power balance	MW	Positive value	Every 60 minutes
4 Scheduled power exchanges by border	MW	for export,	Every 60 minutes
5 Real-time total power balance	MW	negative value	According to the cycle and the quality of secondary controllers (SCADA-like measurement cycle), and at worst not more than every 10 seconds
6 Real-time power exchanges by border	MW	for import, seen from the pTSO sending the data	
7 Generation infeed, if relevant	MW		Every 5 minutes
8 System state	0=Normal 1=Alert 2=Emergency 3=Black-out 4=Restoration		On action from the operator
9 Pre-formatted message	Selection of value between 0 and 20		On action from the operator

transmission system increased and they can immediately react to critical situations in collaboration with partner TSOs by implementing effective remedial actions. EAS is able to provide both types of data, *ie*, raw and processed real time data to each of the member TSOs by the EAS push-pull system that is sending data and provides access to the database, which allows acquisition and provision of processed and raw real time data to TSOs by both Inter-Control Center Communications Protocol (ICCP) and a common visualization server. EAS runs as an application on servers located at the so-called hosting entities, which receives online data, processes them and provides them back to individual TSOs. The data are monitored in nine essential parameters and give a complex image about the balance of every transmission system, planned production of electricity, planned and actual power exchange *etc*.

Altogether, 41 TSOs from 34 countries are members of ENTSO-E, Fig. 1. The ultimate goal of this system is to contribute to the stability of interconnected transmission system and improve the security of electricity delivery to all European inhabitants and to all industrial customers to ensure their connection to a source under any circumstances [3].

3 EXCHANGED DATA

Data, which is the subject of exchange by EAS system, are chosen in such a way as to provide a complete overview of the system in question in normal operation and in critical situations. Nine parameters have been chosen as summarized in Tab. 1.

4 PREDEFINED MESSAGES

When a non-normal system state is set, it is of utmost interest of other TSOs to have indications of the causes or conditions that lead to it. These indications are given using one or more predefined messages from the following list, Tab. 2.

5 FREE TEXT MESSAGES

A special application accessible from a dedicated box on the Control Window opens another window that allows the user to send a free text message with limited characters to any other TSO or sub-group of TSOs by choosing several predefined delivery addresses. The objective is to give precise details of a specific situation (*eg*, expected duration of the incident, name of a grid element ...). The operator can select the target receiver(s): one TSO, all TSOs or a sub-group of TSO (*eg*, a regional group), but every user can see every information.

Any TSO can send messages to the other TSOs or to specific groups of operators. Each operator can open the message list with the received messages. Messages can be acknowledged or deleted in the message list by using appropriate buttons.

Communication is ensured by an electronic highway. The connection between the electronic highway environment and the hosting sites is the point of delivery of data and of the EAS services by the TSOs as well as ENTSO-E, while any failure of the electronic highway environment shall constitute a *force majeure* event.

6 PRACTICAL USE OF EAS

Within the Regional Group of Continental Europe (RG CE), each control area/block is equipped with one secondary controller to minimize the Area Control Error (ACE) in real-time

$$ACE = P_m - P_p + K_i(f_m - f_0). \quad (1)$$

Here,

P_m is the sum of the instantaneous measured active power transfers on the tielines,

P_p is the resulting exchange program with all the neighbouring control areas,

K_i is the K -factor of the control area; a constant (MW/Hz) set on the secondary controller,

$f_m - f_0$ is the difference between the instantaneous measured system frequency and the set-point frequency.

When $\delta f = f_m - f_0 = 0$, under balanced conditions ($P_m = P_p$), the area control error will also be equal to zero.

The desired behaviour of the secondary controller over time will be obtained by assigning a proportional-integral characteristic to control circuits, in accordance with the following equation

$$\Delta P_i = -\beta_i ACE_i - \frac{1}{T_i} \int ACE_i dt. \quad (2)$$

Here,

ΔP_i is the correcting variable of the secondary controller governing control generators in i -th control area,

β_i is the proportional factor (gain) of the secondary controller in i -th control area,

T_i is the integration time constant of the secondary controller in i -th control area [5].

Each TSO is responsible for the quality of power and frequency control within the respective control area.

On 28th October 2013 (between 17:37 and 17:47), a temporary large frequency deviation of up to 130 mHz occurred in the Regional Group of Continental Europe during strong wind conditions in northern Europe. The EAS real-time awareness showed this on the “Frequency” map (the first level of –100 mHz deviation was reached) and on “System State” and “Imbalance” maps it displayed the main cause and location: Normal operation but highly imbalanced situation inside Germany (more

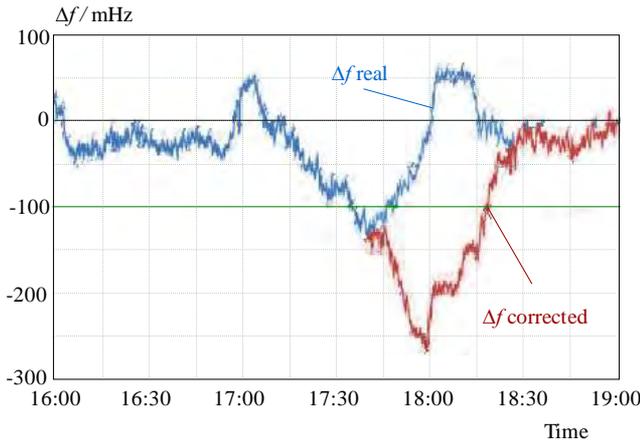


Fig. 2. Frequency in the control area of France

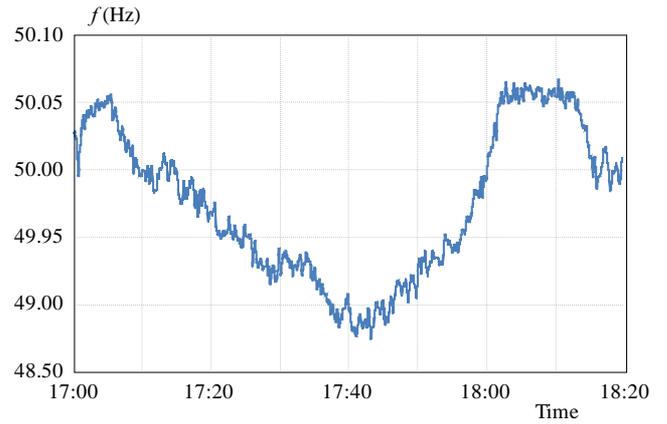


Fig. 3. Frequency in the system of TenneT Germany

Table 2. List of predefined messages

Item	#	Cause leading to the particular system state
General	01	Outage of important element
Flows	02	Relevant N-1 rule criterion violation
	03	Flows beyond transmission limits (overloading)
Balance	04	Loss of significant amount of generation / Unexpected high demand of energy
	05	Unexpected high infeed of energy / Loss of significant amount of consumption
	06	Margin below required minimum
Load shedding	07	Imbalanced system with no margin available
	08	Actions for energy savings
	09	Manual load shedding
	10	Automatic load shedding
Frequency deviation	11	Frequency deviation higher than 200 mHz
	12	Frequency deviation higher than 1 Hz
LFC status	13	LFC frozen mode
	14	LFC frequency mode
Grid	15	Partial islanding within a control area
	16	Large (cross-border) splitting
NCC	17	Security analysis unavailable
	18	SCADA (principal and back-up) not available
	19	National Control Center out of operation
Other	20	Critical event (weather / disaster / terrorism attack)

than -750 MW). TSOs noticed this extraordinary situation via EAS.

In real time, to fill the gap and straighten the system frequency, RTE (TSO France) adjusted its production by 2500 MW. Without the reaction of RTE within the interconnected system the frequency would have dropped down below the limit of 250 mHz that would have caused the National Defence plans to be activated with a questionable reaction of power sources. Corrected and real frequency curves in the Control area France during this extraordinary situation are shown in Fig. 2.

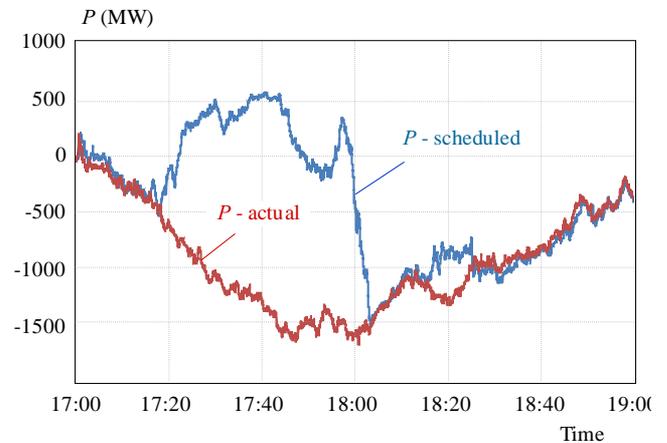


Fig. 4. Imbalance in the control area of TenneT Germany

In Germany, TenneT it is one of the four transmission system operators operating through its subsidiary TenneT TSO GmbH. Real system frequency in the control area TenneT German is presented in Fig. 3.

Finally, Fig. 4 displays the power imbalance in the control area of TenneT Germany.

EAS was not used as expected, as it should have been. There were no messages or system state change in Germany. The added value of the tool appeared too late for RTE operators.

7 EAS IN SOLVING OF CRITICAL SITUATIONS

Emergency operation and all important actions within the synchronous system are covered by the Operation Handbook, Policy 5: Emergency Operations [6]. EAS could be most useful in restoration of the transmission system because the information acquired from individual TSOs, thus the current frequency and power balance of the area, is crucial for determining the frequency and resynchronization leader. Actuality and reliability are the key properties of information in the state of restoration. Availability of all the information for all TSOs from a single system without the need of informing all partners individually is also of high value.

The frequency leader shall announce its nomination and resignation to all RG CE TSOs using EAS. Prior to reconnection, one frequency leader is selected for the rest of the system recovery. This frequency leader shall announce its position to all RG CE TSOs using EAS (precising resignation of the other frequency leader). If the secondary controllers of both frequency leaders were previously in the Frequency Control Mode, one of the two frequency leaders has to switch its secondary control to the Frozen Mode to avoid staying with two secondary controllers in the Frequency Control Mode.

8 CONCLUSION

Mutual real time data exchange is inevitable to ensure reliable operation of the interconnected ENTSO-E system. EAS as a tool for monitoring and sharing operational information of individual TSOs is becoming an essential element of control systems and critical situation scenarios. However, its practical use does not reach the potential possibilities which it was designed for. Determination and definition of conditions of use and decision making rules for dispatchers should be integrated into a collective document approved by ENTSO-E and also into operational documentation or the Operation Handbook.

REFERENCES

- [1] CINTULA, B.—ELESCHOVÁ, Ž.—BELÁŇ, A.—LIŠKA, M.: Transient Stability of Synchronous Generator for Selected Events, Proceedings of the 12th WSEAS International Conference on Electric Power Systems, High Voltages, Electric Machines (POWER '12) **12** (2012), 47–52, Prague.
- [2] CINTULA, B.—VIGLAŠ, D.—BENIUGA, C.-R.: Power System Security Operation in Applying The N-1 Criterion, ELI-TECH12 - 14th Conference of Doctoral Students **14** (2012), 1–6, Bratislava.
- [3] Final Report — System Disturbance on 4 November 2006, https://www.entsoe.eu/fileadmin/user_upload/_library/publications/ce/otherreports/Final-Report-20070130.pdf.
- [4] ENTSO-E launches tendering process on European Awareness System, <https://www.entsoe.eu/news-events/announcements/announcements-archive/Pages/News/entso-e-launches-tendering-process-on-european-awareness-system-.aspx>.
- [5] ENTSO-E Members Launch the European Awareness System to Help Keep Europe Switched On, <https://www.entsoe.eu/news-events/announcements/announcements-archive/Pages/News/entso-e-members-launch-the-european-awareness-system-to-help-keep-europe-switched-on.aspx>.
- [6] ENTSO-E Member Companies, <https://www.entsoe.eu/about-entso-e/inside-entso-e/member-companies/Pages/default.aspx>.
- [7] RG CE Operation Handbook, Appendix 1: Load-Frequency Control and Performance, UCTE, 2004, https://www.entsoe.eu/fileadmin/user_upload/_library/publications/entsoe/Operation_Handbook/Policy_1_Appendix%20final.pdf.
- [8] RG CE Operation Handbook, Policy 5: Emergency Operations, ENTSO-E, 2010, available on https://www.entsoe.eu/fileadmin/user_upload/_library/publications/entsoe/Operation_Handbook/Policy_5_final.pdf.

Received 15 March 2014

František Janíček (prof, Ing, PhD), born in 1954, graduated from the Faculty of Electrical Engineering of the Slovak University of Technology in 1979 and received his PhD degree in electrical power engineering in 1984. Since 1999 he has been full professor, currently Head of the Institute of Power and Applied Electrical Engineering of the Slovak University of Technology. He has authored or co-authored university textbooks and lecture books, four scientific monographs, more than 50 articles in periodicals, and more than 180 lectures at scientific conferences. Professor Janíček is a member of the Slovak Board of the World Energy Congress, statutory officer of the EE Association and member of the Committee on Energy Research and Technology of the International Energy Agency.

Martin Jedinák (Ing), born in 1983, graduated from the Faculty of Electrical Engineering and Information Technology of the Slovak University of Technology in 2008. Currently he works as an analyst at the System Operation Planning Department of the Slovak Electricity Transmission System, joint stock company (Slovenská elektrizačná prenosová sústava, a.s.). His research activities are focused on system security, network analysis and related remedial actions.

Igor Šulc (Ing), born in 1983, graduated from the Faculty of Electrical Engineering and Information Technology of the Slovak University of Technology in 2008. Currently he works at Trade Department of the Slovak Transmission System, joint stock company (Slovenská elektrizačná prenosová sústava, a.s.). His research activities are focused on ancillary services and losses in transmission system.